


POLYFORZA STANDARD FASCIA

BUILT-UP OR MODIFIED VERSION

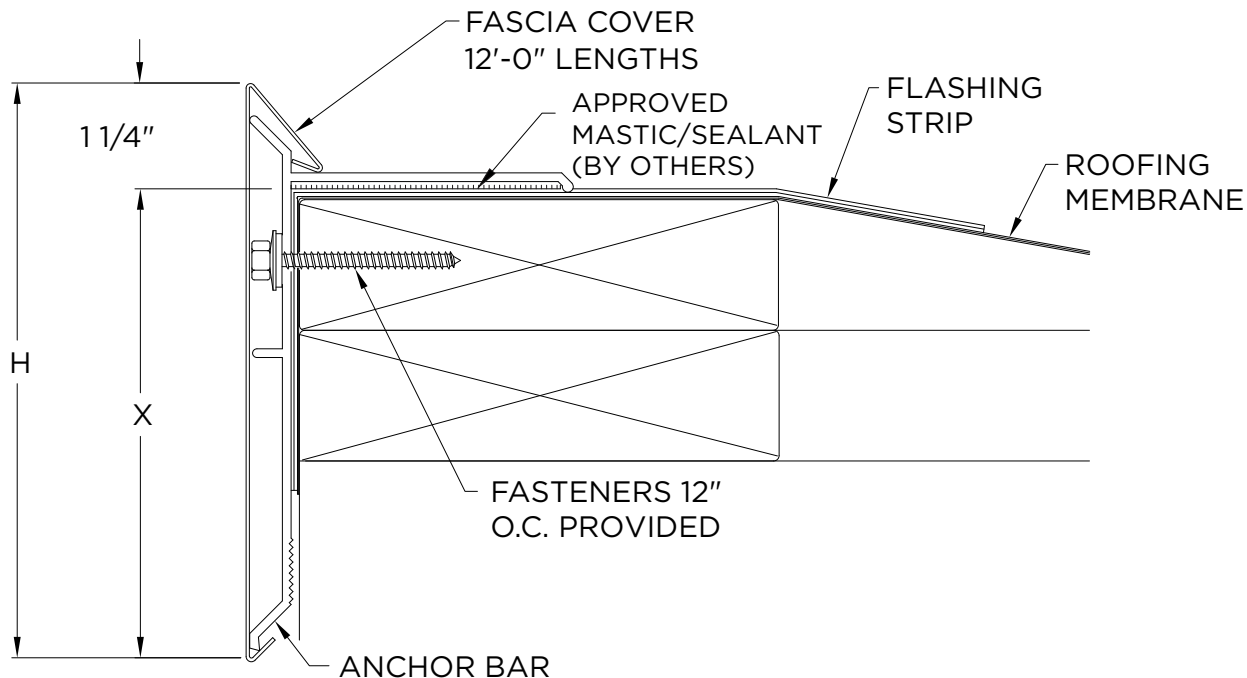

NOTES

- For non-90 miters, see separate print approval
- Product should be installed per provided installation instructions
- ANSI/SPRI/FM 4435/ES-1 Test Pressure up to 275 psf.

APPROVALS



ANSI/SPRI/FM 4435/ES-1
Test Pressures listed in notes

PROJECT INFO

Project Name:

Architect:

Roofing Contractor:

Project Type:

☐ By selecting this box you have verified and confirmed that dimensions, sizes, and quantities are correct. All products will be installed in strict accordance with printed instructions.

Date:

Polyglass USA, Inc.

1111 W. Newport Center Dr.
Deerfield Beach, FL 33442
Customer Service: 800-222-9782
Technical Service: 866-794-9659

SHT# 1 of 1

DATE: 01/10/22

DRN BY: JJC

CKD BY: MM

DWG #: 45010-17199

REV: C

DIMENSIONS

PRODUCT ID. NO.	H DIM	X DIM	NAILER COVERAGE
<input type="checkbox"/> AFM-55	5 1/2"	4 1/4"	1 NAILER
<input type="checkbox"/> AFM-70	7"	5 3/4"	2 NAILERS
<input type="checkbox"/> AFM-85	8 1/2"	7 1/4"	4 NAILERS

MATERIAL

- ☐ 24 Ga. Galv. Steel
☐ 22 Ga. Galv. Steel
☐ .040" Aluminum

Color:

Finish:

Substrate: ☐ Wood

If substrate is not given, wood fasteners will be provided. ☐ Masonry

☐ Metal

☐ OTHER:

QUANTITIES

Lineal Feet (12'-0" Lengths)

Right Endwall Flashing

Outside Miter (90°)

Left Endwall Flashing

Inside Miter (90°)

Right Endcaps

Left Endcaps

Overflow Scupper

☐ Style A

☐ Style B

Spillout Scupper

☐ Style A

☐ Style B

Downspout Scupper

☐ Style A ☐ Style B

Size x

Style A=Tapered 1.5" Drop | Style B=Flat